

3-2012

Farm Energy: Managing swine ventilation controller settings to save energy

Jay D. Harmon

Iowa State University, jharmon@iastate.edu

Michael C. Brumm

Brumm Swine Consultancy, Inc.

Dana Petersen

Iowa State University

Follow this and additional works at: http://lib.dr.iastate.edu/extension_ag_pubs



Part of the [Agricultural Education Commons](#), [Bioresource and Agricultural Engineering Commons](#), and the [Oil, Gas, and Energy Commons](#)

Recommended Citation

Harmon, Jay D.; Brumm, Michael C.; and Petersen, Dana, "Farm Energy: Managing swine ventilation controller settings to save energy" (2012). *Agriculture and Environment Extension Publications*. 34.

http://lib.dr.iastate.edu/extension_ag_pubs/34

Iowa State University Extension and Outreach publications in the Iowa State University Digital Repository are made available for historical purposes only. Users are hereby notified that the content may be inaccurate, out of date, incomplete and/or may not meet the needs and requirements of the user. Users should make their own assessment of the information and whether it is suitable for their intended purpose. For current publications and information from Iowa State University Extension and Outreach, please visit <http://www.extension.iastate.edu>.

FARM ENERGY

Managing swine ventilation controller settings to save energy

Ventilation is by far the largest source of heating energy loss in swine facilities. To maintain air quality, it is essential to provide proper minimum ventilation, but it is also important to avoid expelling excessive energy from the building. Most buildings use electronic controllers that activate fans, heaters, and cooling systems and are designed to interlock the equipment operation to avoid conflicts that waste energy. For instance, if fans and heaters are controlled separately, there can be occurrences when heaters are cycling at the same time the ventilation rate has increased, thereby wasting a great deal of heating fuel. Modern controllers prevent heater operation and ventilation above the minimum rate from occurring at the same time, but improper settings can still contribute significantly to excessive energy consumption.

Terminology

Before addressing how controllers work, it is important to define common terminology. Actual terminology varies among companies that manufacturer controllers.

Setpoint (SP) is a basic temperature setting within the controller that is adjusted as animals grow and their thermal needs change. SP is sometimes called desired room temperature (DRT). When the room temperature is above the SP, ventilation increases to facilitate cooling. Likewise, for room temperatures below the SP, the heater may begin to cycle. Setpoint is not the average temperature, but establishes the line between heating and cooling. During periods of heating, such as during winter when pigs are small, the room temperature will remain a little below the SP. During periods of cooling, room temperature will be above the SP.

Heaters normally have two parameters, both set in the controller. Many controllers use a heater "on" and "off" temperature, while others use a **differential**, the number of degrees between when the heater comes on and when it goes off, and an **offset**, the number of degrees below the SP at which point the heater turns off. For example, if the SP was set to 68°F, the differential set to 1°F and the offset set to 1.5°F, the heater would start when the room temperature drops to 65.5°F (SP minus the sum of the differential and offset). The heater would then run until the room temperature reaches 66.5°F as shown in Figure 1.

Variable speed fans are used for most swine ventilation systems to provide minimum ventilation. Two settings are required for basic fan control. **Minimum speed** is a setting in the controller that represents the minimum ventilation rate. The value displayed by the controller may or may not correspond to the percentage of full speed air flow or motor RPM. Most variable speed fans move 50% of their rated airflow at approximately 65% of their full speed rpm. The minimum ventilation fans operate at the minimum speed any time the temperature is below the SP. Above the SP, the minimum ventilation fans gradually increase speed as the temperature rises. The number of degrees it takes the fan to reach 100% is called the **bandwidth** or **range**.

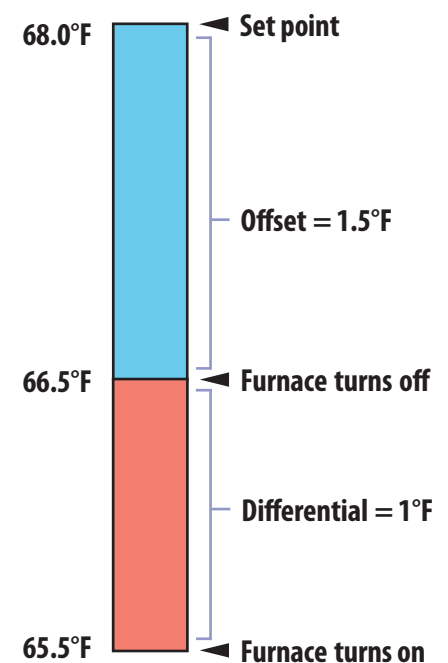


Figure 1. Differential and offset.



Potential problems

High energy consumption can be associated with improper heater settings. When the building temperature drops to the heater “on” temperature, the heater ignites and provides heat until the controller senses the heater “off” temperature. Because air is a fluid, it takes some time for the heat to circulate throughout the building, especially if heaters are oversized. This causes the temperature to continue to rise even after the heater has shut down. This is why the heater “off” temperature is set 1.5 to 2°F below the SP. When the heater shuts off at a temperature too near the SP, the room temperature may exceed the SP, which will cause the minimum ventilation fans to increase their speed. This effectively means that the heater has used fuel to heat the room and then the fans are exhausting that heated air to cool the room, because the temperature has crossed into the range of cooling temperatures. This can cause a tremendous waste of energy. Figure 2 shows an example of such an occurrence.

The left side of the graph shows the furnace run time when it was set to come on 2°F below SP and turn off at 1°F below. The right side shows the furnace stopped running when the off temperature was changed from 1°F below to 1.5°F below SP. This resulted in a savings of 3.75 gallons of fuel per furnace per day. In this case, a small increase in the temperature difference between the SP and when the heater turns off prevented the cycling and reduced fuel usage significantly.

If the furnace size is relatively large compared to room or facility size, as observed by the furnace not running for long even in extreme cold conditions, the off temperature must be set lower relative to the SP to avoid the problem of exhausting heated air when the room temperature continues to rise as the rapidly heated air disperses throughout the building.

A similar situation can occur if sensors are improperly located. Sensors should be located where they are representative of the mixed air in the building. They should not be impacted by sprinklers, cold air from inlets, or hot air from heaters. Proper controller settings can have a big impact on energy usage. Even a slight change may dramatically improve energy efficiency and yield immediate savings.

No endorsement of products or firms is intended, nor is criticism implied of those not mentioned.



Impact of furnace offset on furnace run time

Offset changed at noon (blue vertical line)

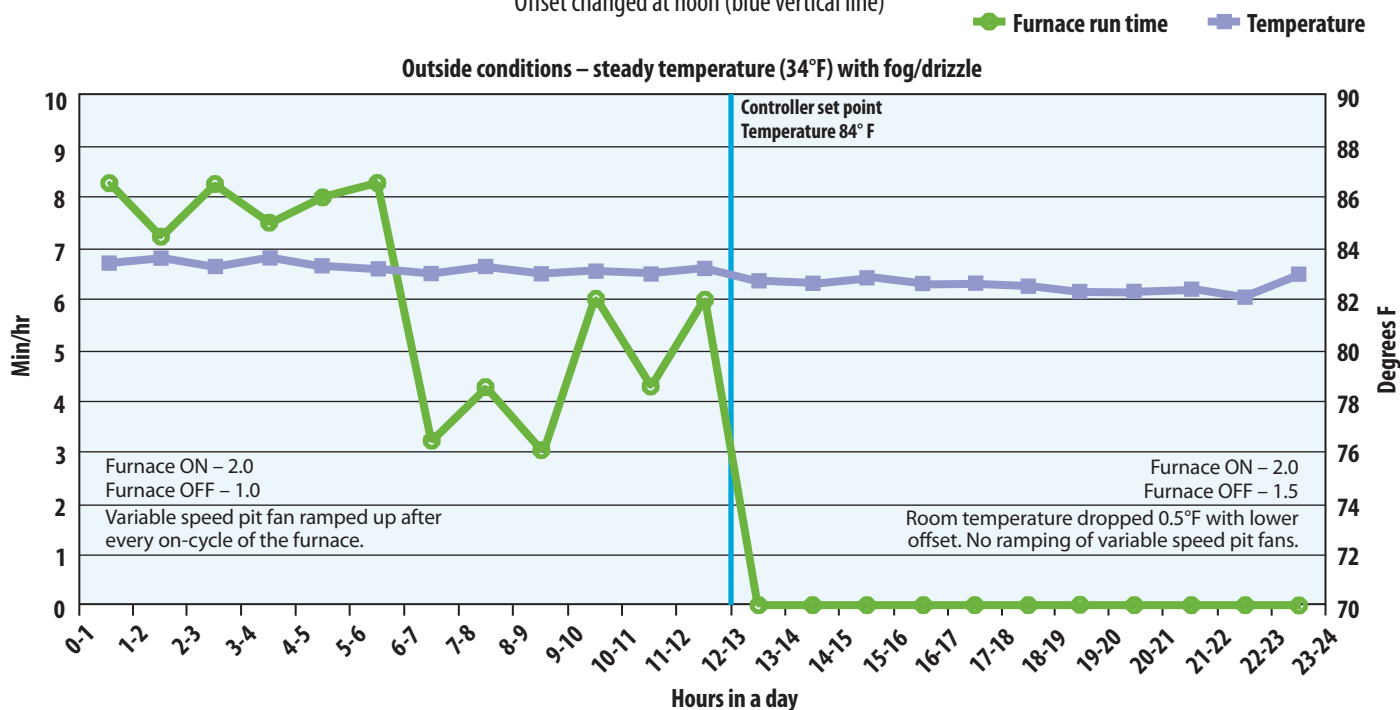


Figure 2. Impact of furnace offset on furnace run time. *Courtesy of Brumm Swine Consultancy.*

Prepared by Jay Harmon, professor, ag and biosystems engineering; Mike Brumm, professor emeritus in animal science at University of Nebraska–Lincoln and Brumm Swine Consultancy; and Dana Petersen, program coordinator, ISU Farm Energy Initiative; Iowa State University Extension and Outreach. Sponsored by the Iowa Energy Center.

... and justice for all

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at 202-720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue SW, Washington, DC 20250-9410, or call 800-795-3272 (voice) or 202-720-6382 (TDD). USDA is an equal opportunity provider and employer. Issued in furtherance of Cooperative Extension work, Acts of May 8 and June 30, 1914 in cooperation with the U.S. Department of Agriculture. Cathann A. Kress, director, Cooperative Extension Service, Iowa State University of Science and Technology, Ames, Iowa.